


SECTION A-A  
NOT TO SCALE

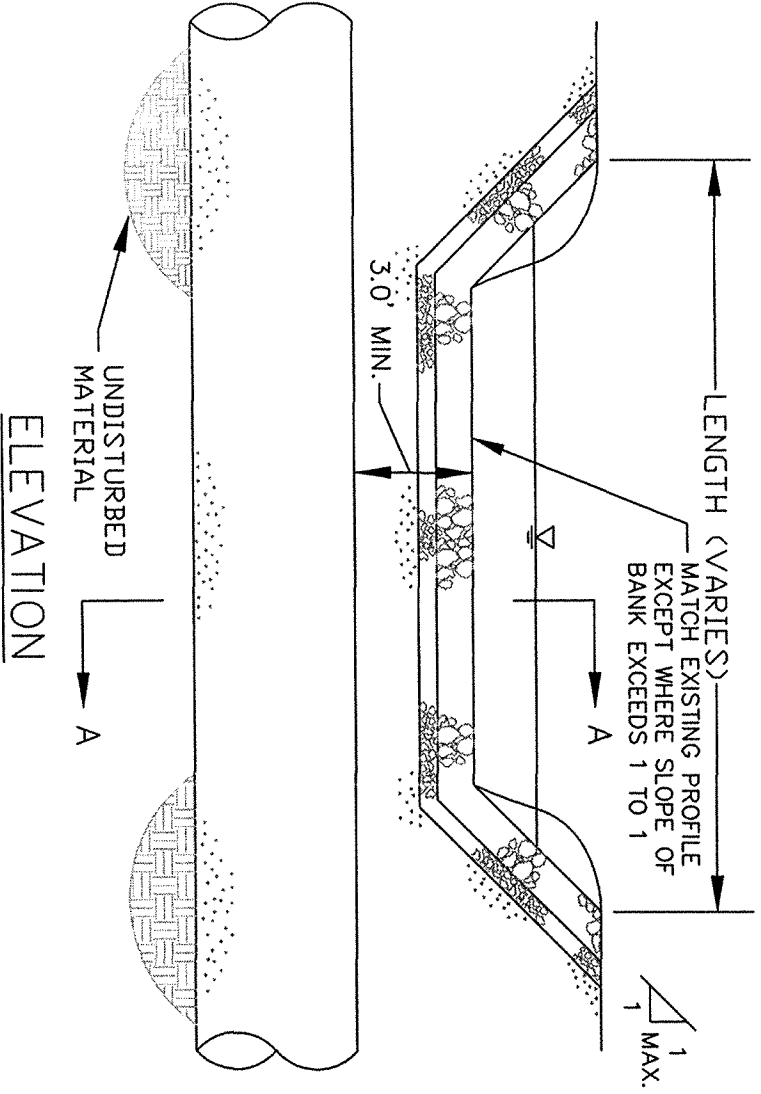

NOTE: WHEN BEDROCK IS ENCOUNTERED AND COVER EQUALS OR EXCEEDS 3', THE TRENCH SHALL BE BACKFILLED WITH COMPACTED #67 STONE AND TOPPED WITH 18" OF CLASS 1 RIPRAP.

TYPICAL STREAM CROSSING  
CITY OF ROCKY MOUNT  
DEPT. OF ENGINEERING

APPROVED -	STD. NO. 5.18
DATE 04-07-00	REVISION -

REVISIONS		
NO	DATE	DESCRIPTION