

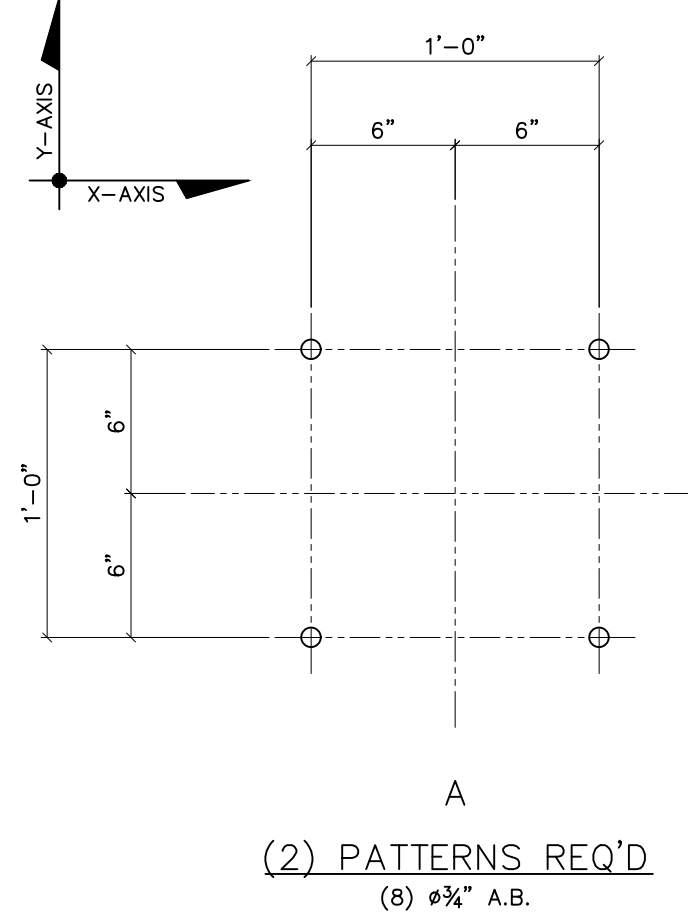
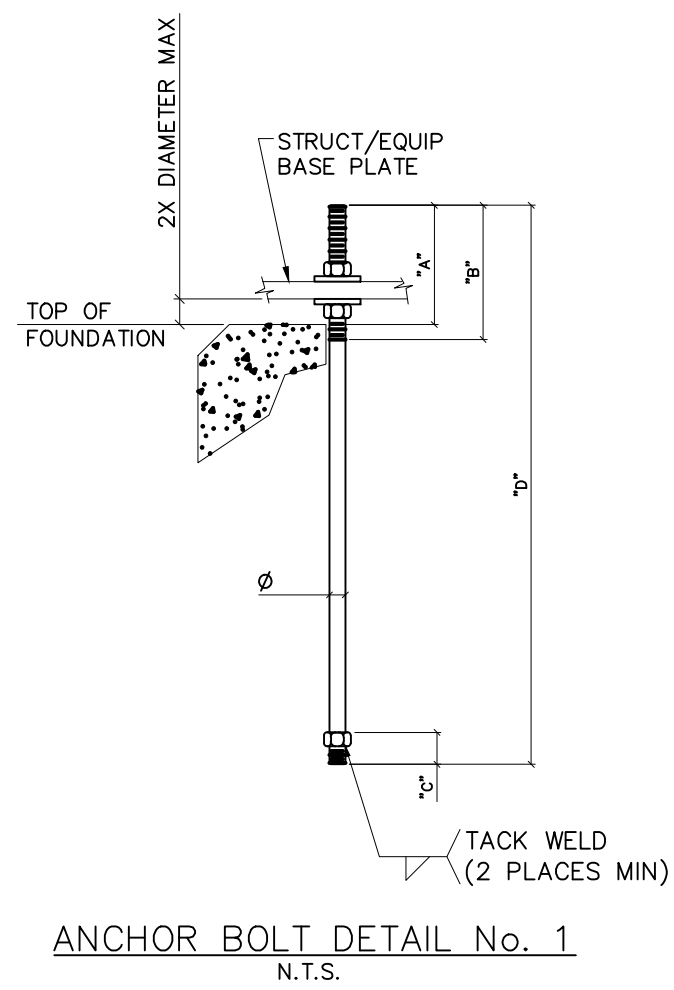


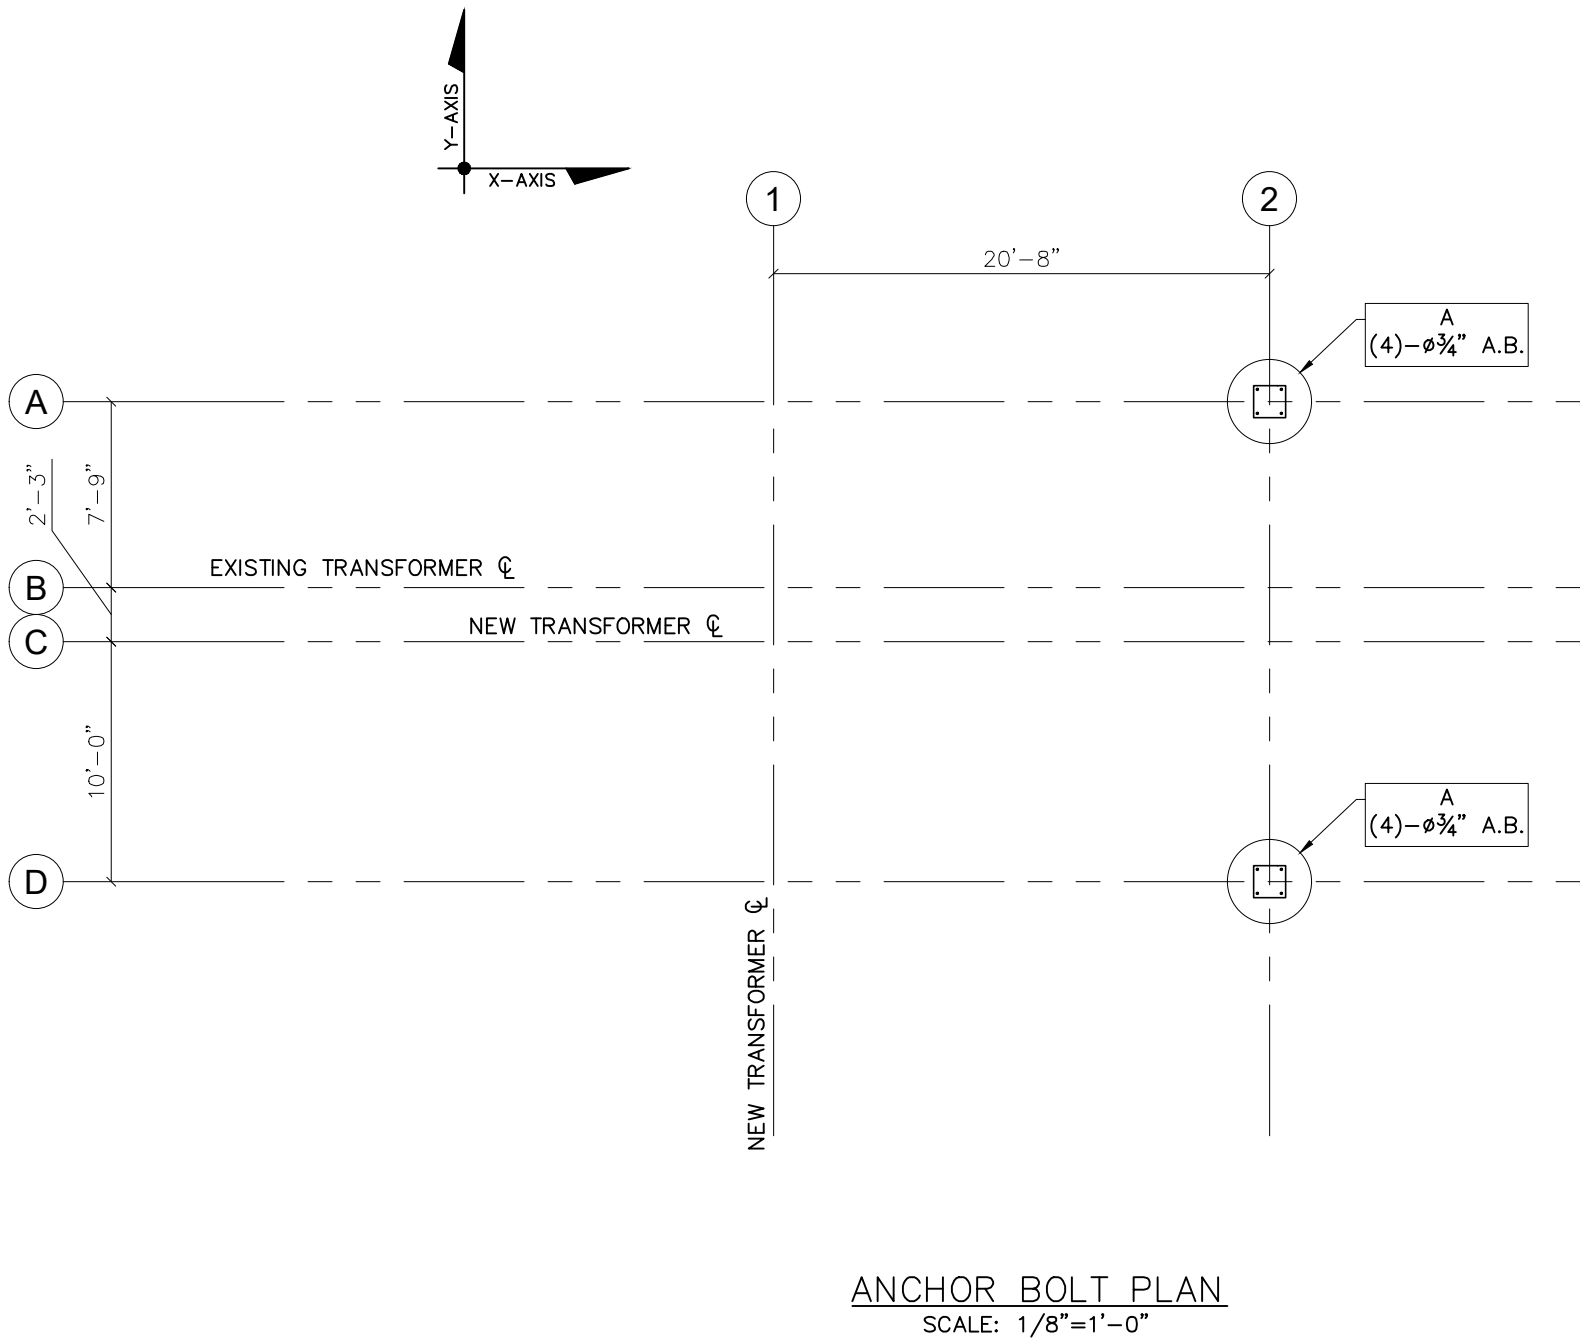

ANCHOR BOLT SUMMARY												
SERVICE	ANCHOR BOLTS PATTERN NO.	PATTERN QTY.	ANCHOR BOLTS ITEM NO.	BOLT QTY./EA	BOLT QTY./TTL	DIAM. Ø	"A" PROJECTION LENGTH	"B" THREAD LENGTH/TOP	"C" THREAD LENGTH/BOTTOM	"D" BOLT LENGTH	DETAIL	SPECIFICATION
BUS SUPPORT	A	2	AB-1	4	8	3/4"	4"	6"	2"	2'-6"	1	ASTM F1554-GR55
NOTE: BOLTS SHALL BE HOT-DIP GALVANIZED A MINIMUM OF 2" PAST TOP THREAD IN ACCORDANCE WITH ASTM A123.												

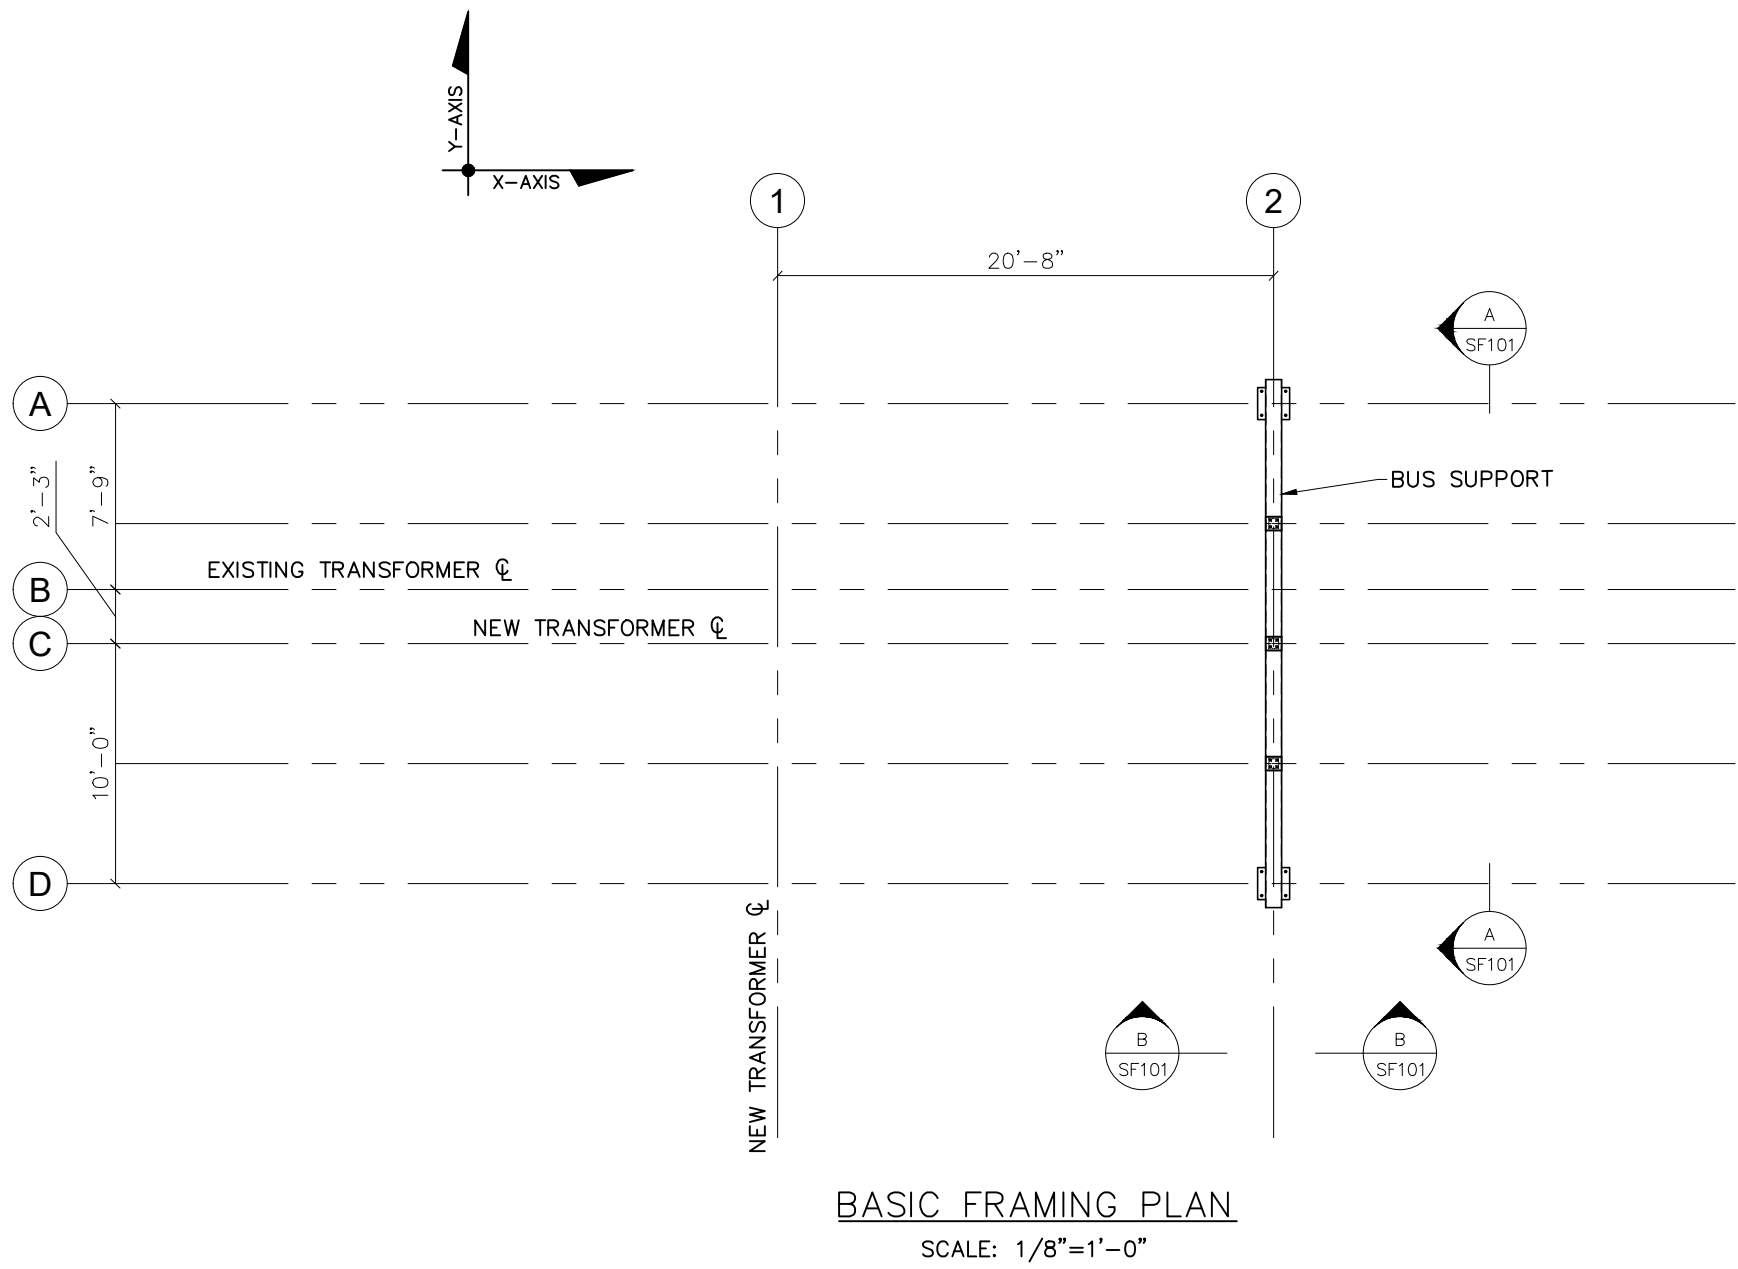

ROCKY MOUNT
ENERGY RESOURCES
THE CENTER OF IT ALL

Booth & Associates
2203 Redwood Drive Suite 300 Raleigh NC 27607
NC F-0221



NORTH CAROLINA
PROFESSIONAL
SEAL
053203
VELVIZHI KUMARASEL

06/07/2022
© 06/2022

NO.	ISSUED FOR CONSTRUCTION	REVISIONS	ENG.	DATE
0			VK	06/07/22

PROJECT NAME:
ROCKY MOUNT SOUTH POD 230kV

DRAWING TITLE:
BASIC FRAMING PLAN &
ANCHOR BOLT PLAN

DRAWN BY:	DJD
CHECKED BY:	RSD
APPROVED BY:	VK
DATE:	06/07/22
SCALE:	1/8"=1'-0"
FILE NUMBER:	18899
SHEET:	

SF-100