



- NOTES:
1. BACKFILL SHALL BE INSTALLED AND COMPACTED IN 6" - 8" UNIFORM LIFTS.
  2. BACKFILL SHALL BE COMPACTED TO A MIN. DENSITY OF 100% AS DETERMINED BY AASHTO T-99 FOR SOIL OR T-180 FOR STONE.
  3. CUT-BACK TO BE PERFORMED AFTER TRENCH BACKFILL AND COMPACTION.
  4. TIME FROM INITIAL CUT TO FINAL BACKFILL & PATCH SHALL NOT EXCEED 5 DAYS UNLESS APPROVED BY DIRECTOR OF ENGINEERING.

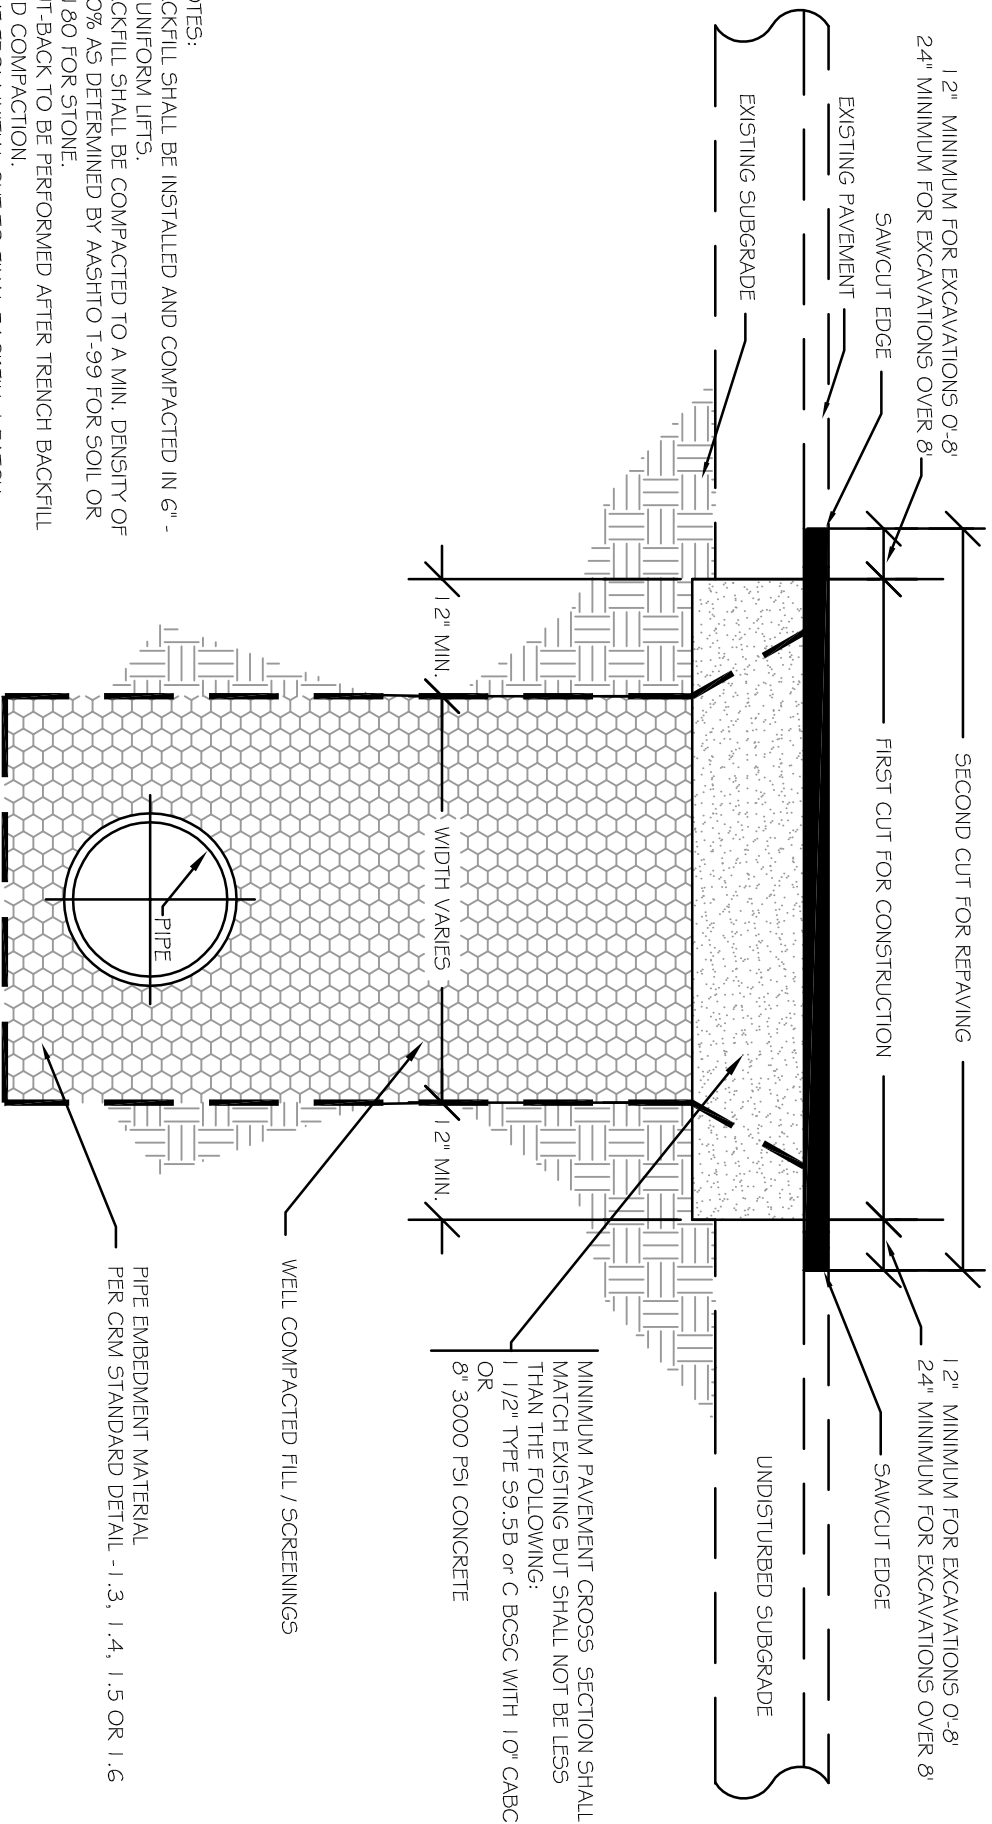

MINIMUM PAVEMENT CROSS SECTION SHALL MATCH EXISTING BUT SHALL NOT BE LESS THAN THE FOLLOWING:  
 1 1/2" TYPE S9.5B OR C BCSC WITH 10" CABC  
 OR  
 8" 3000 PSI CONCRETE

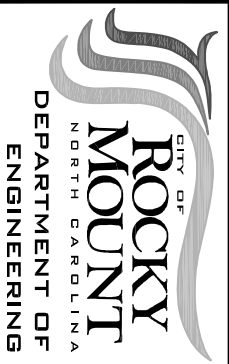

PAVEMENT PATCHING UTILITY INSTALLATION

DATE: OCTOBER 2012	STANDARD #: 1.1
APPROVED:	SHEET # 1 OF 1
REVISION:	