


COATED STEEL BAND OR STAINLESS STEEL CASING INSULATORS AS MANUFACTURED BY ADVANCE PRODUCT SYSTEMS, INC., MODEL SS1, S1; OR BY CASCADE MODEL #CCS-905, OR BY SPIDER MANUFACTURING, INC., MODEL SP-1 THRU SP-20 OR APPROVED EQUAL.

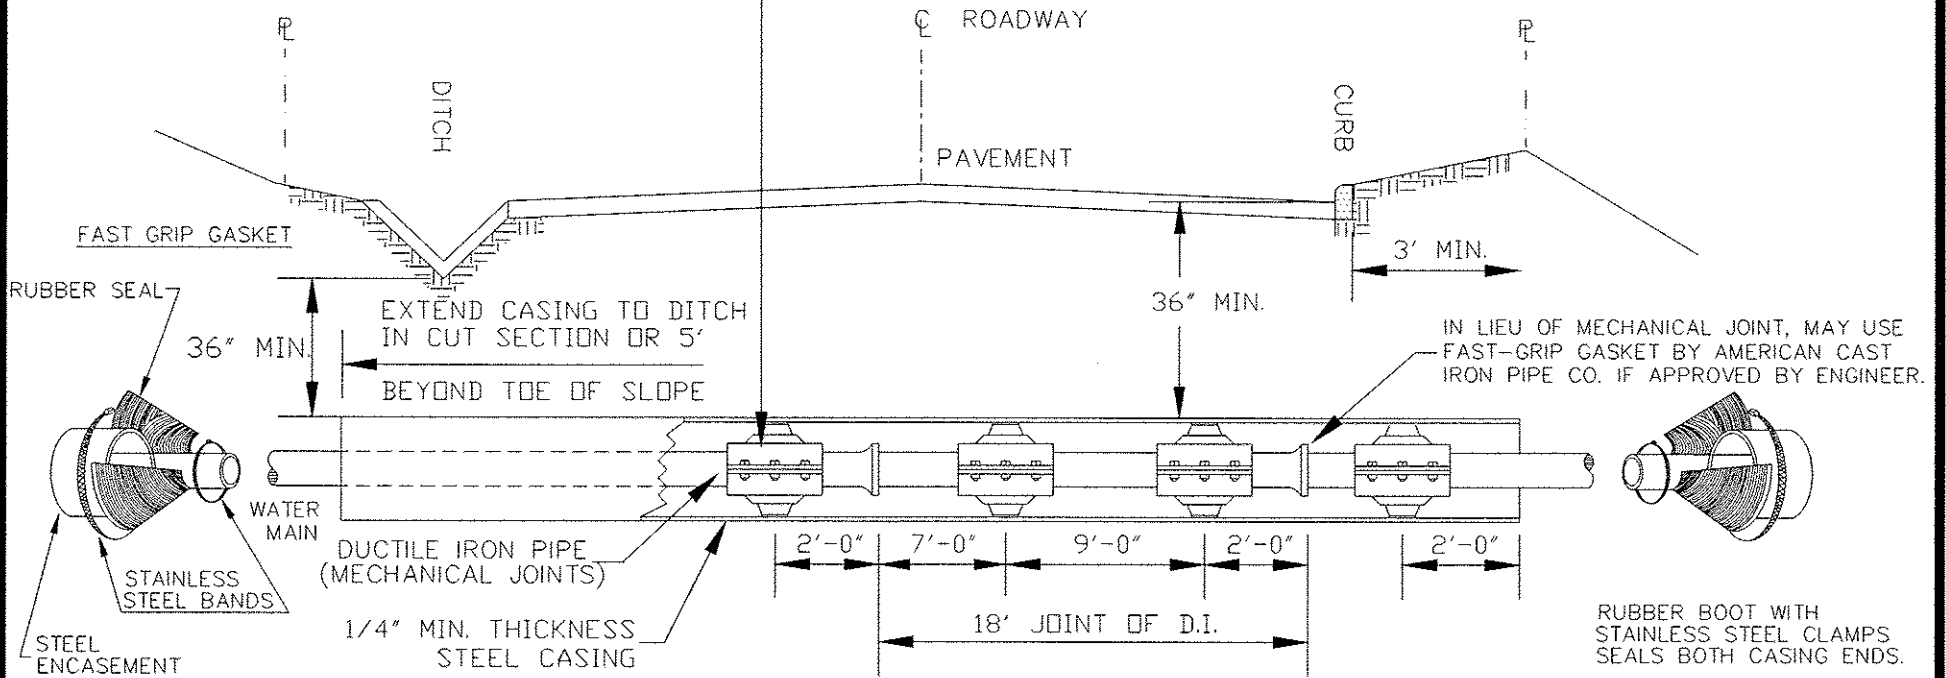

- NOTE:
1. ALL PIPELINES LARGER THAN 4" IN NOMINAL INSIDE DIAMETER INSTALLED BY BORING AND JACKING SHALL BE INSTALLED WITH STEEL ENCASEMENT (1/4" MIN. THICKNESS.)
 2. ENDS OF CASING CAN BE SEALED USING A RUBBER BOOT WITH STAINLESS STEEL CLAMPS, OR APPROVED EQUAL IN LIEU OF MASONRY FILL.
 3. STEEL CASING SHALL EXTEND A MINIMUM OF 3' BEYOND BACK OF CURB, SIDEWALK, OR PAVEMENT EDGE. FOR STRIP PAVED STREETS, CASING SHALL EXTEND TO DITCH IN CUT SECTIONS OR TO 5' BEYOND TOE OF SLOPE IN FILL SECTIONS.
 4. WHEN CARRIER PIPE IS USED FOR CONVEYING LIQUID FLAMMABLE SUBSTANCES, VENT PIPES SHALL BE PROVIDED FROM ENDS OF CASING TO PROPERTY LINE.
 5. MAY USE PVC C-900 OR EQUIVALENT AS THE CARRIER PIPE AS APPROVED BY THE ENGINEER. ALL CARRIER PIPE JOINTS MUST BE RESTRAINED.

TYPICAL ENCASED DRYBORE FOR ROADWAYS

CITY OF ROCKY MOUNT
DEPT. OF ENGINEERING

APPROVED
-

DATE
6-30-09

STD. NO.
1.7

REVISION
-

REVISIONS		
NO	DATE	DESCRIPTION