


Notes: 1. Concrete shall be Class B (2,500 psi min. compressive strength).

2. Concrete thickness shall be 6".
3. Wheelchair ramp intersections shall meet current ADA requirements. Retrofit as needed per CRM std. 2.2.1 - 2.2.3.
4. Where shown on plans, specified by Engineer, or existing subgrade must be removed due to soft, wet, frozen or yielding subgrade being encountered, #57 or #67 clean, washed stone bedding shall be provided, or CABC where shown on plans.

CONCRETE BUS SHELTER PAD - Existing Sidewalk

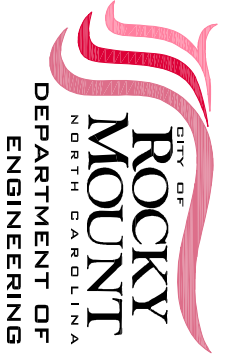

DATE: December 19, 2012      STANDARD #: 1.21

APPROVED:      SHEET # 1 OF 1

REVISION: