


SIDE ELEVATION
24" ROLL TYPE CURB & GUTTER

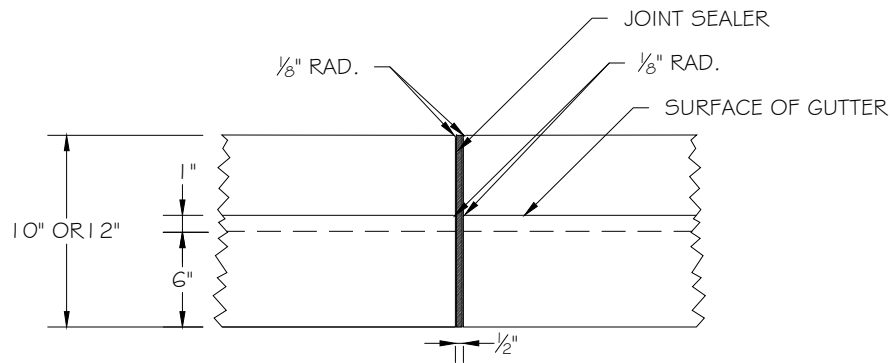

FRONT ELEVATION
TRANSVERSE EXPANSION JOINT
IN CURB AND GUTTER

GENERAL NOTES:

ALL CURB AND GUTTERS ARE TO BE POURED WITH CLASS "A" CONCRETE. (3000 PSI)

FLEXIBLE FORMS ARE TO BE USED WHEN RADII IS LESS THAN 200'.

CONTRACTION JOINTS SHALL BE SPACED AT 10' INTERVALS. JOINT SPACING MAY BE ALTERED BY THE ENGINEER TO PREVENT UNCONTROLLED CRACKING.

CONTRACTION JOINTS MAY BE INSTALLED BY THE USE OF TEMPLATES OR FORMED BY OTHER APPROVED METHODS. WHERE SUCH JOINTS ARE NOT FORMED BY TEMPLATES, A MINIMUM DEPTH OF 1 1/2" SHALL BE OBTAINED.

ALL CONTRACTION JOINTS SHALL BE FILLED WITH JOINT FILLER.

EXPANSION JOINTS SHALL BE SPACED AT 90' MAX. INTERVALS, ADJACENT TO ALL RIGID OBJECTS.



STANDARD 24" ROLL TYPE CURB & GUTTER

DATE: APRIL 2014

STANDARD #: 2.5

APPROVED:

SHEET # 1 OF 1

REVISION: