


MEDIAN CURB AND GUTTER  
SIDE ELEVATION

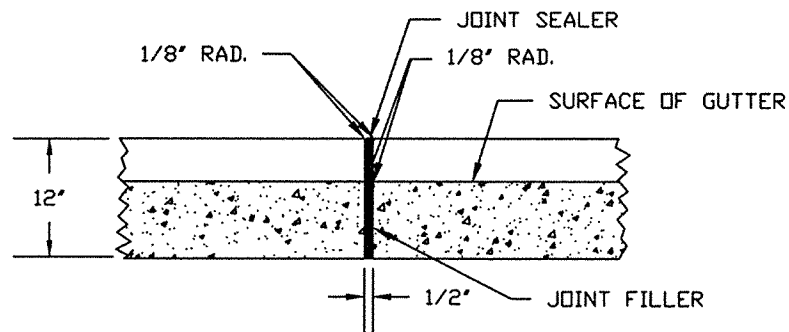

TRANSVERSE EXPANSION JOINT  
IN CURB AND GUTTER

GENERAL NOTES:

ALL CURB AND GUTTERS ARE TO BE POURED WITH CLASS "A" CONCRETE. (3000 PSI)

FLEXABLE FORMS ARE TO BE USED WHEN RADII IS LESS THAN 200'.

CONTRACTION JOINTS SHALL BE SPACED AT 10' INTERVALS. JOINT SPACING MAY BE ALTERED BY THE ENGINEER TO PREVENT UNCONTROLLED CRACKING.

CONTRACTION JOINTS MAY BE INSTALLED BY THE USE OF TEMPLATES OR FORMED BY OTHER APPROVED METHODS. WHERE SUCH JOINTS ARE NOT FORMED BY TEMPLATES, A MINIMUM DEPTH OF 1 1/2" SHALL BE OBTAINED.

ALL CONTRACTION JOINTS SHALL BE FILLED WITH JOINT FILLER.

EXPANSION JOINTS SHALL BE SPACED AT 90' MAX. INTERVALS, ADJACENT TO ALL RIGID OBJECTS.

**STANDARD 18" MEDIAN CURB & GUTTER**

REVISIONS		
NO	DATE	DESCRIPTION

**CITY OF ROCKY MOUNT**  
**DEPT. OF ENGINEERING**

**APPROVED**  
-

**DATE**  
02-26-03

**STD. NO.**  
2.6

**REVISION**  
-