



VALLEY GUTTER CROSS SECTION

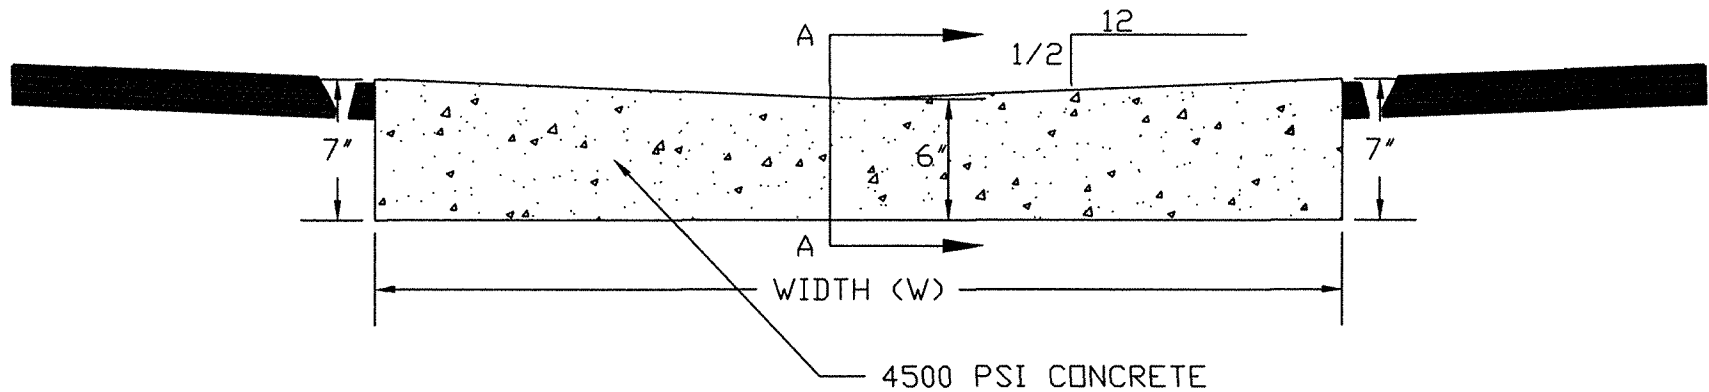

SECTION A - A

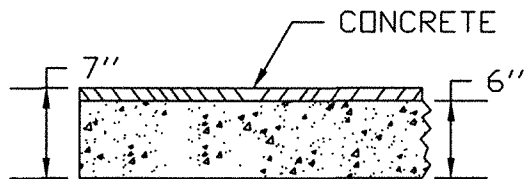

W	C & G WIDTH
36"	24"
48"	30"

GENERAL NOTES:

ALL VALLEY GUTTERS ARE TO BE POURED WITH CLASS "AA" CONCRETE. (4500 PSI)
 CONTRACTION JOINTS SHALL BE HAND TOOLED AND SPACED AT 10' INTERVALS. JOINT SPACING MAY BE ALTERED BY THE ENGINEER TO PREVENT UNCONTROLLED CRACKING.
 CONTRACTION JOINTS MAY BE INSTALLED BY THE USE OF TEMPLATES OR FORMED BY OTHER APPROVED METHODS. WHERE SUCH JOINTS ARE NOT FORMED BY TEMPLATES, A MINIMUM DEPTH OF 1 1/2" SHALL BE OBTAINED.
 ALL CONTRACTION JOINTS SHALL BE FILLED WITH JOINT FILLER.
 EXPANSION JOINTS SHALL BE SPACED AT 90' MAX. INTERVALS AND ADJACENT TO ALL RIGID OBJECTS INCLUDING PREVIOUS CONCRETE POURS. A MINIMUM OF TWO EXPANSION JOINTS SHALL BE PROVIDED AT CONNECTION BETWEEN EITHER VALLEY GUTTER AND CURB & GUTTER OR AT POINTS OF CURVATURE AND TANGENCY FOR DRIVEWAY OR INTERSECTION RADII.

STANDARD 36" & 48" VALLEY GUTTER

REVISIONS		
NO	DATE	DESCRIPTION

CITY OF ROCKY MOUNT
DEPT. OF ENGINEERING

APPROVED	STD. NO.
	2.7
DATE	REVISION
02-20-03	