



## STANDARD SIDEWALK SECTION

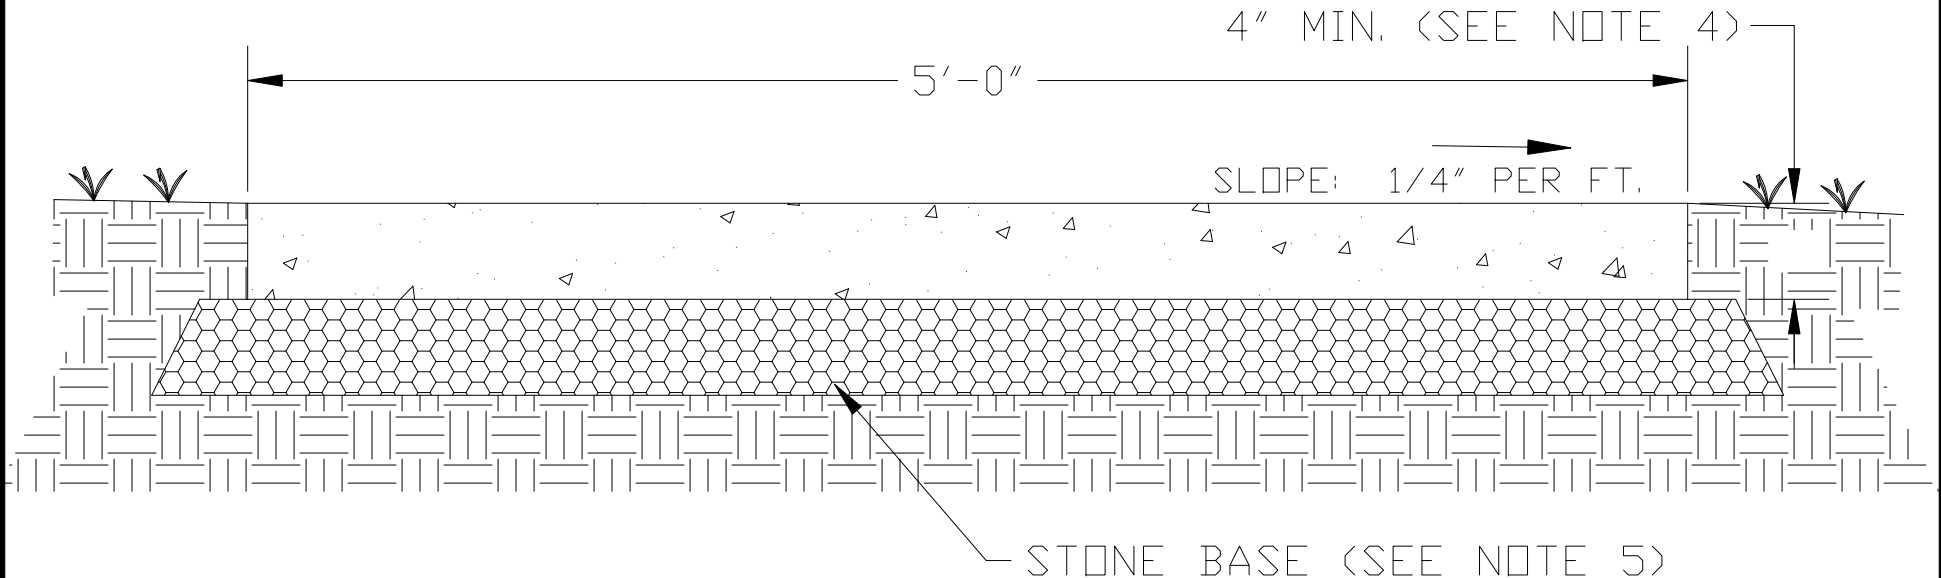

# TRANSVERSE EXPANSION JOINT

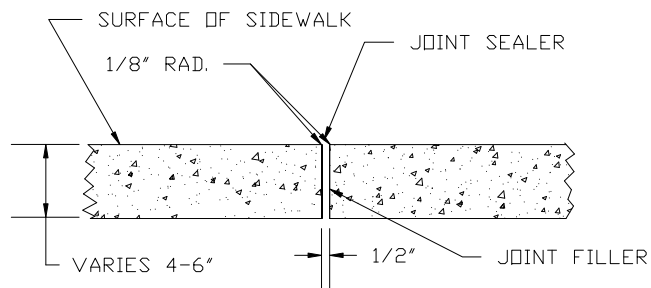

NOTES:

1. CONCRETE SHALL HAVE 3000 PSI COMPRESSIVE STRENGTH.
2. SIDEWALK CONTRACTION JOINTS SHALL BE HAND TOOLED AND SHALL BE PROVIDED EVERY FIVE (5) LINEAR FEET.
3. EXPANSION JOINTS SHALL BE PROVIDED EVERY 30 LINEAR FEET.
4. SIDEWALK THICKNESS SHALL BE INCREASED TO 6" AT DRIVEWAYS.
5. WHERE SHOWN ON PLANS, SPECIFIED BY ENGINEER, OR EXISTING SUBGRADE MUST BE REMOVED DUE TO SOFT, WET, FROZEN, OR YIELDING SUBGRADE BEING ENCOUNTERED, #57 OR #67 CLEAN, WASHED STONE BEDDING SHALL BE PROVIDED, OR CABC WHERE SHOWN ON PLANS.
6. A MINIMUM SEPARATION OF 2' IS REQUIRED BETWEEN THE SIDEWALK AND THE BACK-OF-CURB.

# STANDARD SIDEWALK CROSS SECTION

REVISIONS			CITY OF ROCKY MOUNT DEPT. OF ENGINEERING	APPROVED	STD. NO.
NO	DATE	DESCRIPTION			2.20
				DATE	REVISION
				09-09-09	