


NOTES:

1. FOR HYDRANT INSTALLATION ON EXISTING MAIN, USE TAPPING SLEEVE AND VALVE PER STANDARD # 5.12
2. RESTRAINING GLANDS MAY BE USED IN LIEU OF THREADED RODS IF APPROVED BY ENGINEER.

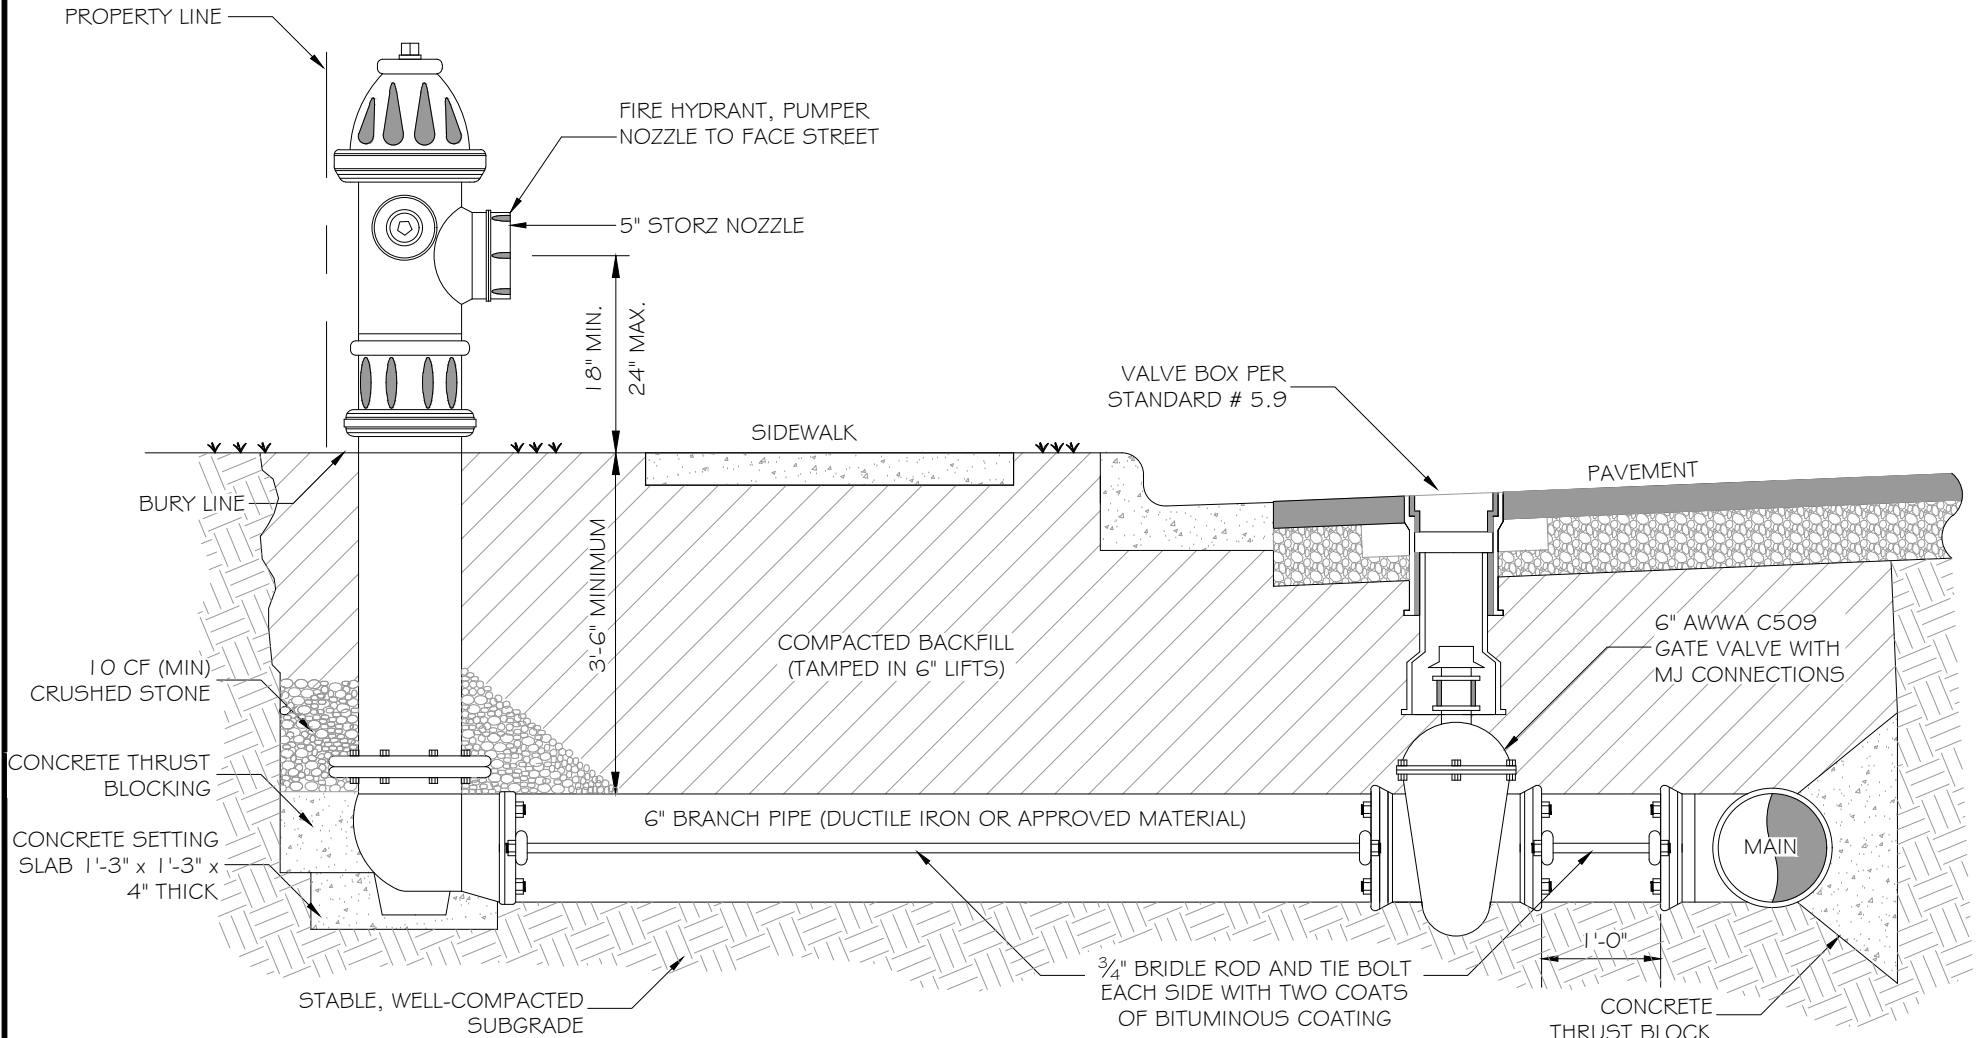

HYDRANT INSTALLATION (SHEET 1 OF 2)

DATE: NOVEMBER 2019	STANDARD #: 5.1
APPROVED:	SHEET # 1 OF 2
	REVISION: