


DIRECT TAPS MAY BE ON DUCTILE IRON MAINS ONLY. ALL OTHERS SHALL BE MADE WITH A TAPPING SADDLE PER T-14.15.4.

METERED SERVICES	SIZE "F" (I.D.)
11-20	2"
5-10	1-1/2"
4	1"
2	3/4"

SEE DETAIL FOR STANDARD WATER TAP INSTALLATION STD. NO. 5.5

SHUT OFF VALVE AND ROADWAY BOX SHALL BE PROVIDED FOR ALL ASSEMBLIES. FOR FOUR METERS OR LESS, A CURB STOP SHALL BE PROVIDED. FOR FIVE OR MORE METERS, USE A 2" I.B.B.M. DOUBLE DISC OR RESILIENT WEDGE TYPE GATE VALVE.

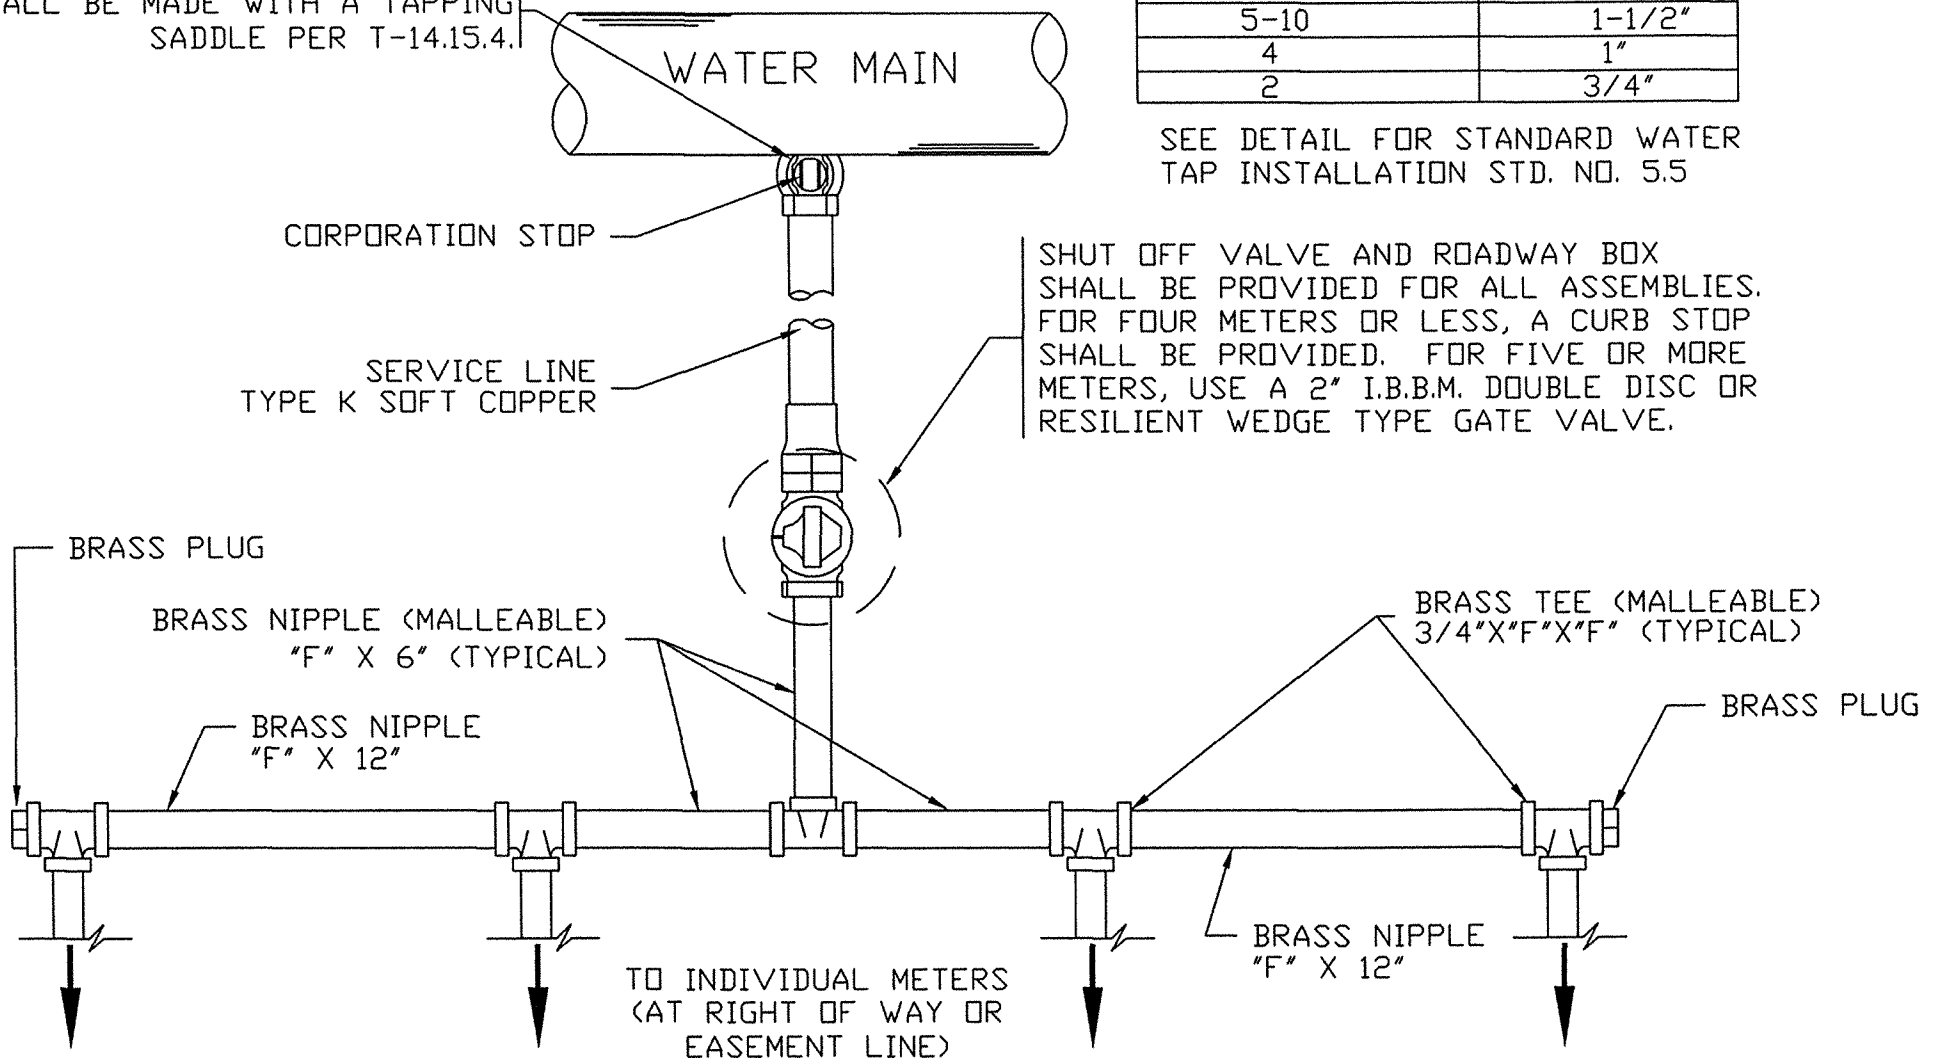

STANDARD GANG METER ASSEMBLY

REVISIONS		
NO	DATE	DESCRIPTION

CITY OF ROCKY MOUNT
DEPT. OF ENGINEERING

APPROVED	-
DATE	04-07-00

STD. NO.	5.6
REVISION	-