
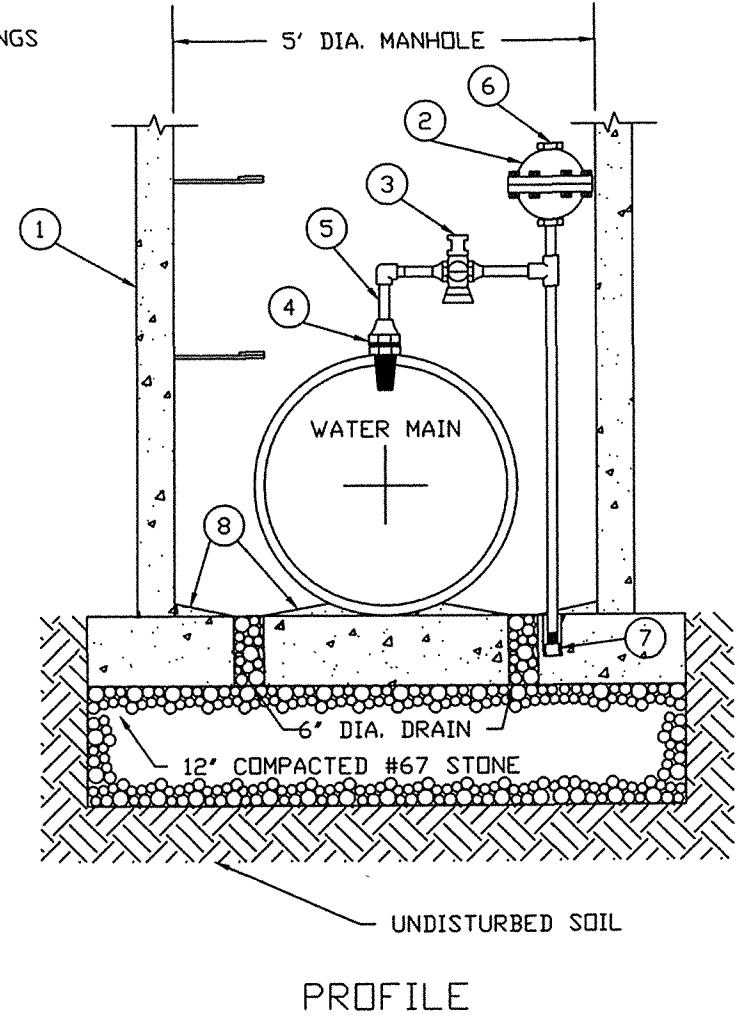


BILL OF MATERIALS

- 1.) PRECAST MANHOLE
- 2.) 2" AIR RELEASE VALVE
- 3.) 2" GATE VALVE
- 4.) 2" CORPORATION COCK
- 5.) 2" MECHANICAL JOINT BRASS PIPE AND FITTINGS
- 6.) TRASH HOOD
- 7.) PIPE CAP
- 8.) GROUT, 1/8":1'-0" MIN. SLOPE TO DRAIN

1" ASPHALTIC SEALER FOR CUSHION

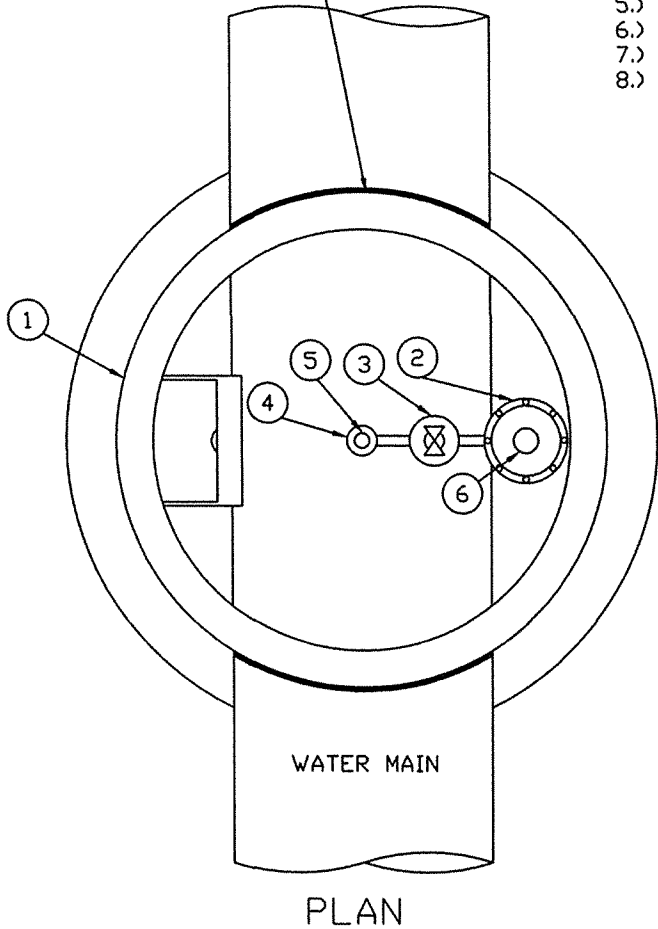

NOTE: AIR RELEASE VALVE SHALL BE P-20 WITH VACUUM CHECK BY CRISPIN OR APPROVED EQUAL.

STANDARD MANHOLE AND AIR RELEASE VALVE (6" THRU 24" MAINS)

REVISIONS		
NO	DATE	DESCRIPTION

CITY OF ROCKY MOUNT
DEPT. OF ENGINEERING

APPROVED	STD. NO.
-	5.16
DATE	REVISION
04-07-00	-