
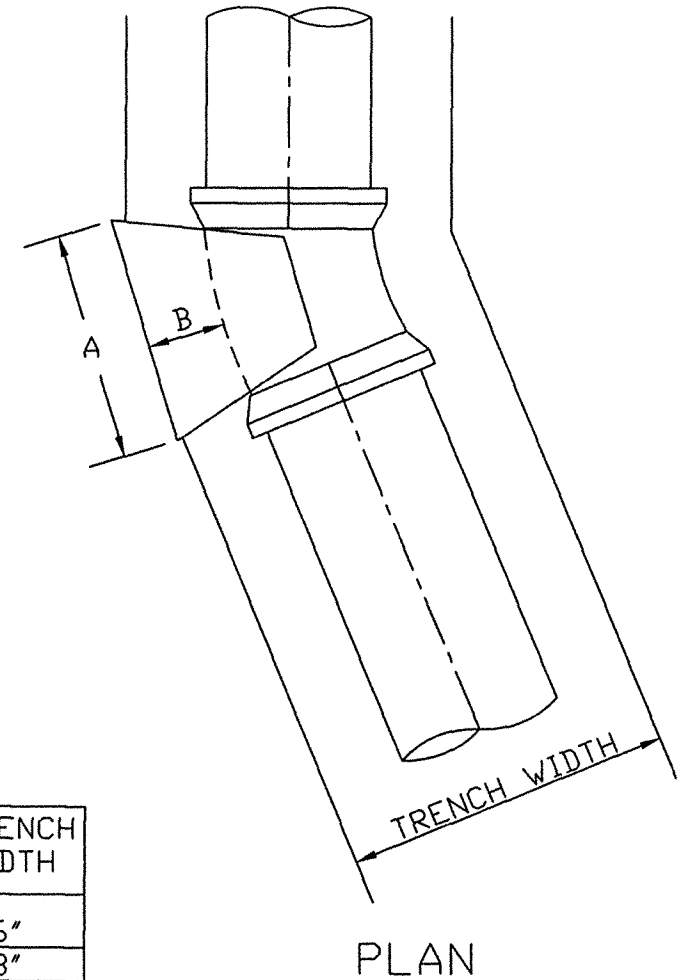


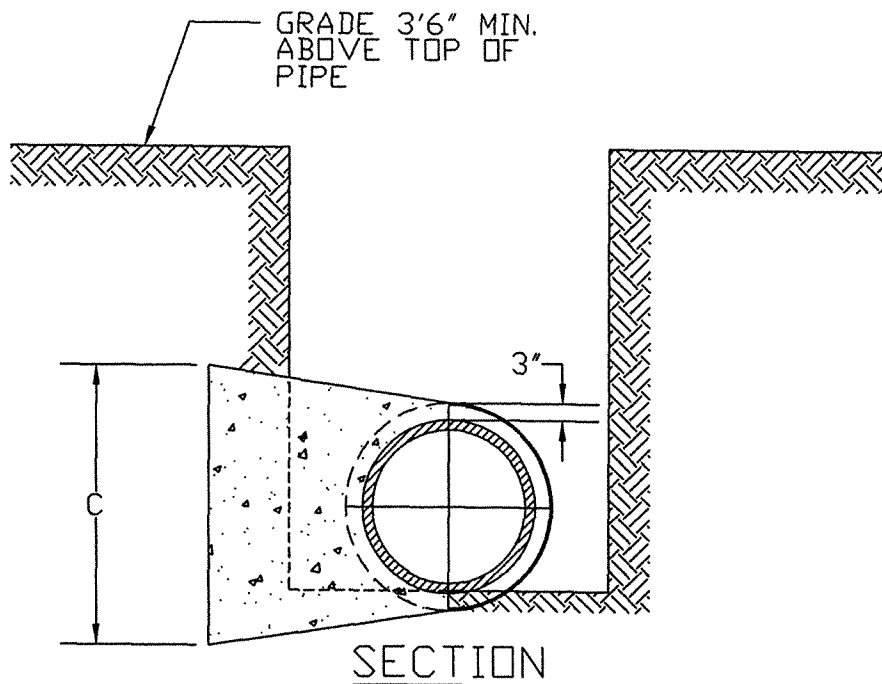

2500 P.S.I. CONCRETE
CLASS B
REQUIRED

NOMINAL DIAMETER	A	B	C	TRENCH WIDTH
6"	1'0"	1'0"	1'0"	2'6"
8"	1'4"	1'0"	1'2"	2'8"
12"	2'0"	1'0"	1'6"	3'0"
16"	2'8"	1'0"	1'10"	3'4"
20"	3'0"	1'0"	2'2"	3'8"
24"	3'0"	1'0"	3'0"	4'0"
30"	4'0"	1'6"	3'6"	4'6"

TRENCHING & BLOCKING OF 22 1/2° BENDS

REVISIONS		
NO	DATE	DESCRIPTION

CITY OF ROCKY MOUNT
DEPT. OF ENGINEERING

APPROVED -	STD. NO. 5.21
DATE 07-13-01	REVISION -