


- NOTES: 1. SUBDRAIN SHALL TIE OR EMPTY INTO CATCH BASINS ONLY.  
 2. PERFORATED SUBDRAIN SHALL BE 6" MIN., CORRUGATED, GALVANIZED STEEL PIPE MANUFACTURED IN ACCORDANCE WITH AASHTO M-36 (ARMCO HEL-COR OR APPROVED EQUAL) OR DUAL WALL POLYETHYLENE PIPE MANUFACTURED IN ACCORDANCE WITH AASHTO M-252 TYPE S (HANCOR SURE LOCK F-47 OR APPROVED EQUAL).  
 3. IF POLYETHYLENE PIPE IS USED, A TRACER WIRE SHALL BE ATTACHED TO THE PIPE FOR USE IN LOCATING THE PIPE.

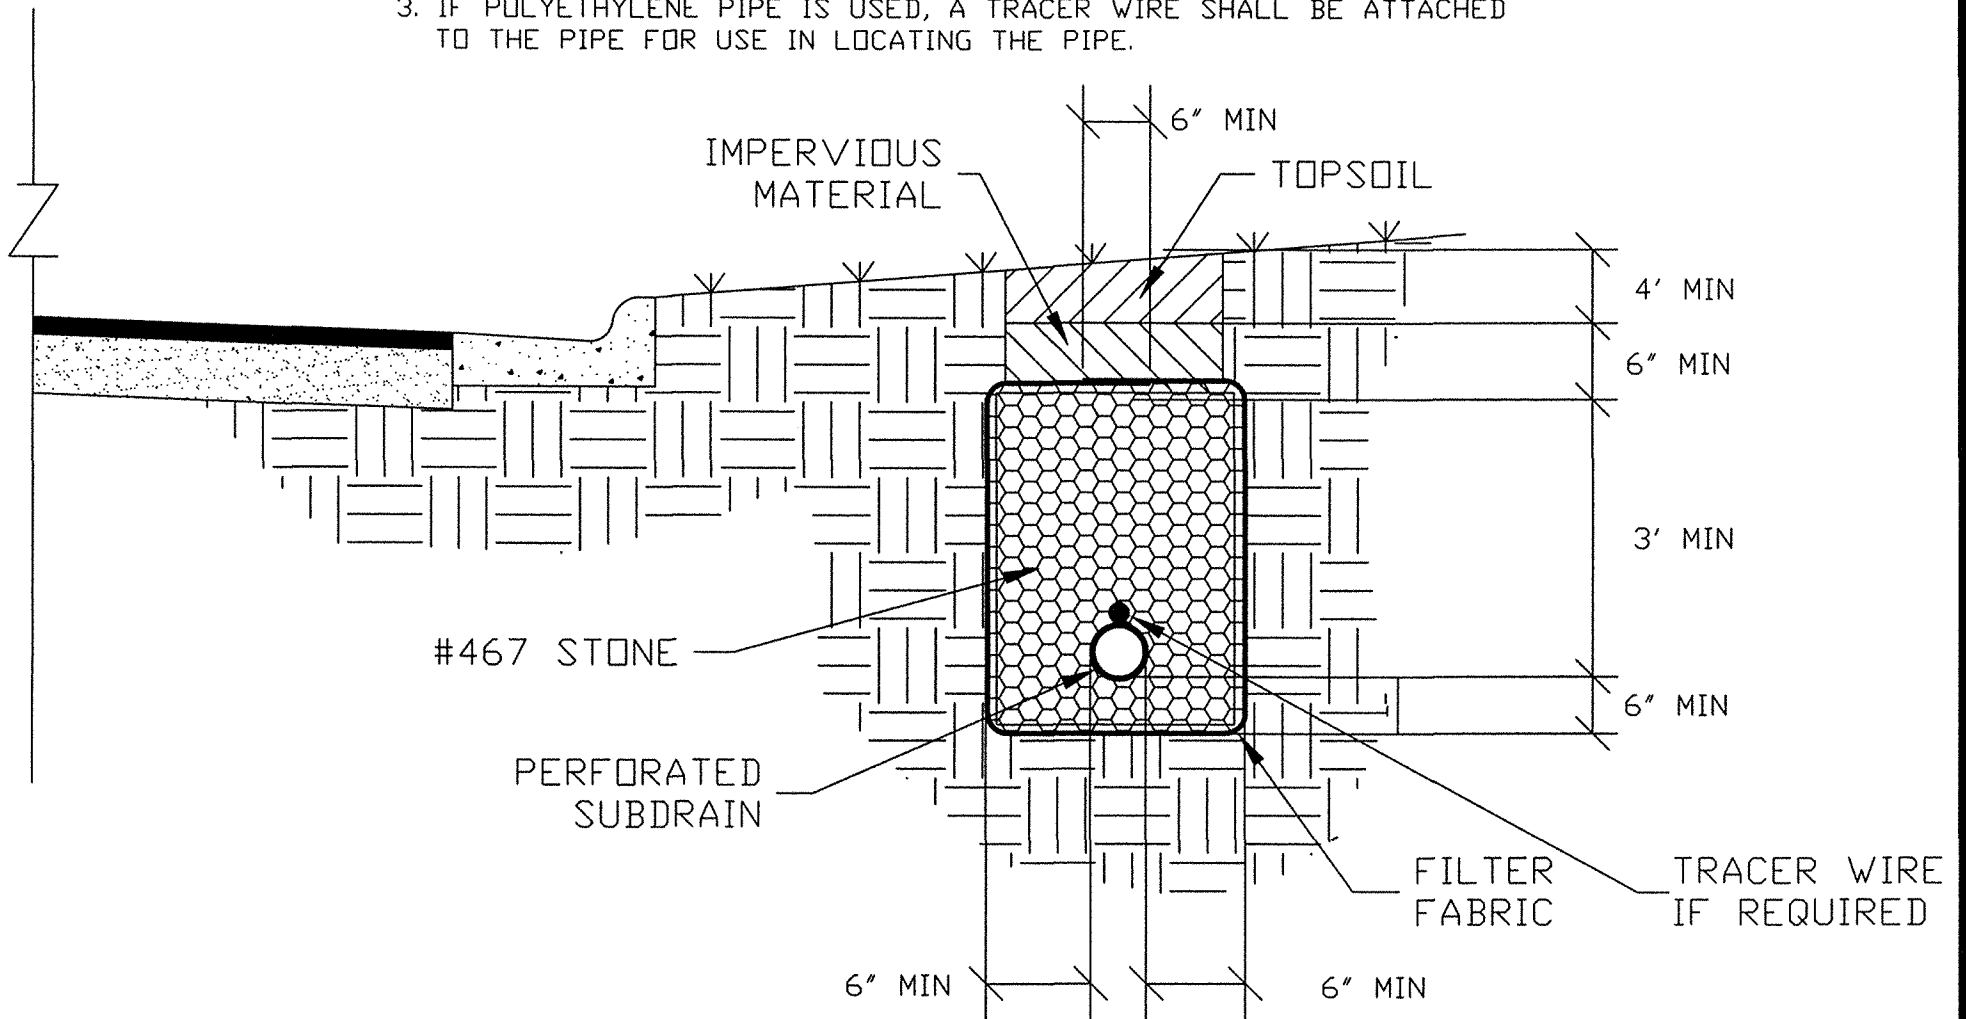

**STANDARD SUBDRAIN ALONG EDGE OF STREET**

REVISIONS		
NO.	DATE	DESCRIPTION

**CITY OF ROCKY MOUNT  
 DEPT. OF ENGINEERING**

<b>APPROVED</b> -
<b>DATE</b> 11-6-01

<b>STD. NO.</b> 6.33
<b>REVISION</b> -